

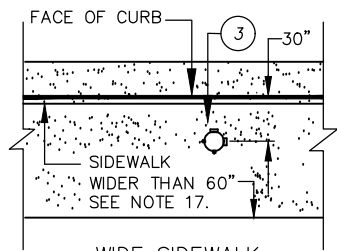


ITEM MATERIALS


- 1 STANDARD HYDRANT, 8-HOLE PATTERN, WITH (1) 4-INCH AND (1) 2½-INCH FIRE HOSE OUTLETS, CLOW 850 OR 2050, OR JAMES JONES 3710 OR 4040B. PAINT FIRE HYDRANT AND CAPS RUST-O-LEUM OLD CAT YELLOW - 76486.
- 2 MAINLINE SIZE x 6-INCH MJ x MJ x FLG DI TEE WITH RESTRAINED JOINTS. INSTALL CONCRETE THRUST BLOCK PER CITY STD. DWG. 401 ON NON-RESTRAINED JOINT WATERLINES.
- 3 REPLACE SIDEWALK PER CITY STD. 142 OR CONSTRUCT 48" x 36" x 6" THICK CONCRETE PAD WITHIN PARKWAY. SEE HYDRANT LOCATION PLANS BELOW FOR APPLICABLE CONDITION.
- 4 6-INCH DIA. FLG x FLG DI SPOOL, AWWA C115.
- 5 6-INCH DIA. FLG x MJ DI 90-DEGREE BEND, RESTRAINED.
- 6 6-INCH DIA. DI PIPE, CLASS 350, RESTRAINED JOINT.
- 7 6-INCH RESILIENT WEDGE GATE VALVE FLG x MJ RESTRAINED PER CITY STD. DWG. 420.
- 8 6-INCH DIA. FLANGE DI 90-DEGREE BEND.
- 9 CONCRETE THRUST BLOCK PER CITY STD. DWG. 401.
- 10 VALVE BOX PER CITY STD. DWG. 422.
- 11 FIRE HYDRANT CAPS, PLASTIC W/O CHAINS.
- 12 BREAK-OFF BOLTS. 5/8" x 3" W/ BOLTS UP. 8-HOLE PATTERN, PRE-FILLED BOLTS WITH SILICONE INSTALLED UP.
- 13 MJ PIPE RESTRAINT, EBBA IRON MEGALUG SERIES 1100.
- 14 6-INCH DIA. DI SPOOL WITH 1/4-INCH V (SINGLE OR DOUBLE) BREAK OFF GROOVE.

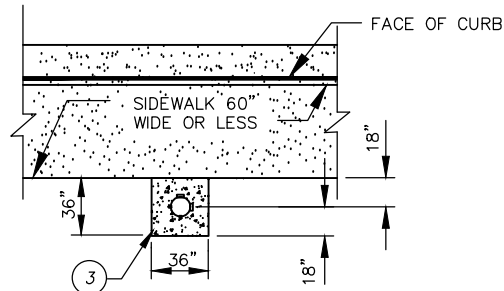

(ONLY BY WRITTEN APPROVAL OF DWP GENERAL MANAGER OR DESIGNEE)

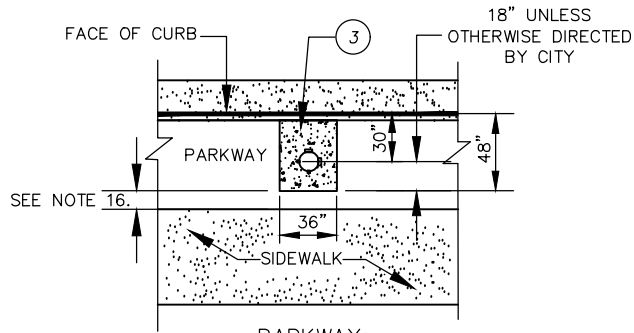

**NARROW SIDEWALK
CONDITION 2**

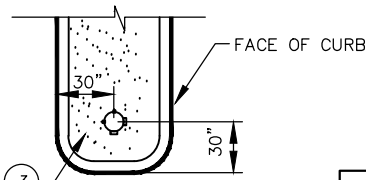

**MEDIAN
CONDITION 4**

HYDRANT LOCATION PLANS




SEE NOTES ON SHEET 2.

NOT TO SCALE

REVISION			APPROVED:		CITY OF CORONA
NO.	APPROVED	DATE	DATE	DATE	
1		05/30/18	<i>Tom Koper</i> TOM G. KOPER, PE. CITY ENGINEER	10/01/20	
2		12/28/18	<i>Vernon R. Weisman</i> VERNON R. WEISMAN, PE. DISTRICT ENGINEER	10/01/20	SHEET 1 OF 2
3	VRW	10/01/20			

NOTES:

1. FLANGE NUTS, BOLTS, AND WASHERS SHALL BE TYPE 316SS. LUBRICATE BOLTS WITH ANTI-SEIZE LUBRICANT.
2. CONSTRUCT CONCRETE THRUST BLOCK ON MAINLINE TEE PER CITY STD. DWG. 401 WHERE WATER MAIN IS NOT OTHERWISE FULLY RESTRAINED.
3. DIMENSIONS MAY VARY FOR SPECIAL CIRCUMSTANCES; CUL-DE-SACS, PRIVATE STREETS, SIDEWALKS ADJACENT TO CURBS, ETC. WHERE SPECIFICALLY REQUIRED ON THE APPROVED PLANS.
4. CHISEL A 1½-INCH TALL "V" IN THE CURB FACE TO INDICATE LOCATION OF VALVE.
5. CHISEL (2) "X"'S AND THEIR RESPECTIVE DISTANCES IN THE CURB TO BE USED AS "TIE" LOCATIONS FOR VALVE CAN.
6. 6-INCH LATERAL PIPELINE (FULLY RESTRAINED) SHALL MATCH THE CLASS OF THE ADJACENT MAIN LINE PIPE.
7. VALVE SHALL BE ACCESSIBLE AT ALL TIMES.
8. DEVELOPER/INSTALLER SHALL SUPPLY AND PLACE BLUE-DOT REFLECTING RAISED ROADWAY MARKERS PER CITY STD. DWG. 531.
9. BORE UNDER CURB & GUTTER FOR CONSTRUCTION OF HYDRANT LATERAL.
10. PROVIDE 3-FOOT MINIMUM HORIZONTAL CLEARANCE BETWEEN FIRE HYDRANT AND ALL OTHER ADJACENT ABOVE GROUND IMPROVEMENTS.
11. PROVIDE 1½-INCH OPERATING NUTS ON ALL FIRE HYDRANT OPERATORS.
12. WRAP PIPE AND VALVE WITH A DOUBLE LAYER OF 8-MIL BLUE POLYETHYLENE.
13. ALL FITTINGS, PIPE, VALVES, AND FITTINGS SHALL BE LEAD FREE IN COMPLIANCE WITH FEDERAL AND STATE LAWS.
14. DO NOT CONSTRUCT FIRE HYDRANT CLOSER THAN 10 FEET TO DRIVEWAY RETURN WITHOUT PRIOR APPROVAL BY DWP GENERAL MANAGER OR DESIGNEE.
15. CONDITIONS 2 AND 3 ARE STANDARD CITY CONFIGURATION.
16. EXTEND PAD TO SIDEWALK IF END OF PAD IS 24-INCH OR CLOSER TO SIDEWALK.
17. FOR ALTERNATIVE TO WIDE SIDEWALK CONDITION 1 HYDRANT LOCATION, SEE CITY STD. 144.
18. CONSTRUCT FIRE HYDRANT WITHIN THE CITY RIGHT-OF-WAY OR EASEMENT UNLESS EXCEPTION IS PROVIDED IN WRITING BY DWP GENERAL MANAGER OR DESIGNEE.

6" POTABLE WATER FIRE HYDRANT BLOW-OFF ASSEMBLY			
REVISION		APPROVED:	
NO.	APPROVED	DATE	DATE
1	VRW	05/30/18	5/31/2018
		 NELSON D. NELSON, P.E. PUBLIC WORKS DIRECTOR	
		 VERNON R. WEISMAN, P.E. DISTRICT ENGINEER	
		DATE	
			
			CITY OF CORONA
			STD 416
			SHEET 2 OF 2