
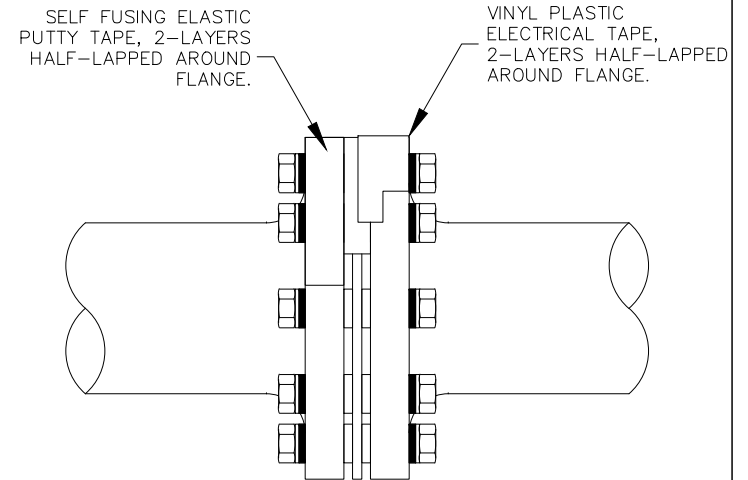


BURIED INSULATING FLANGE COATING

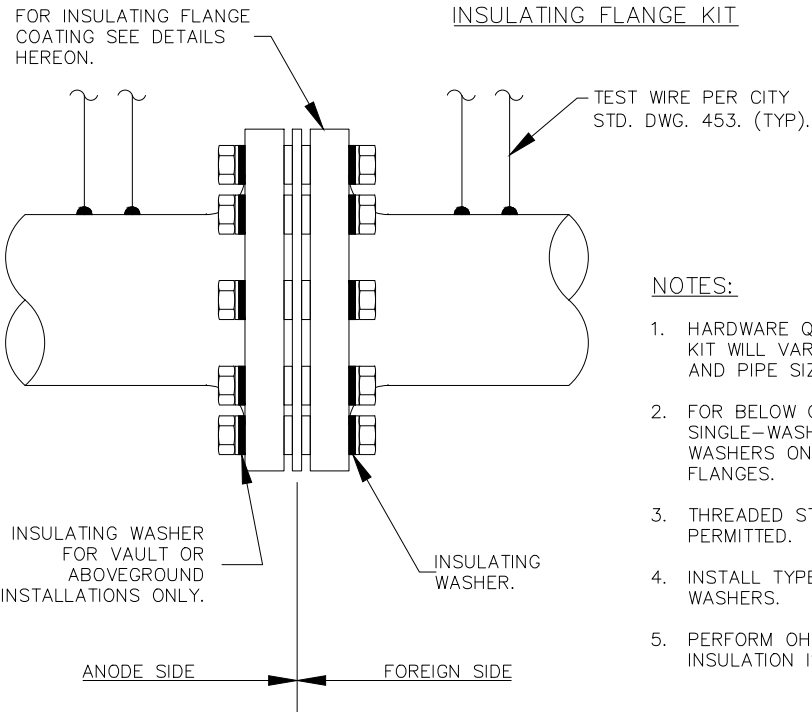


ABOVE GROUND INSULATING FLANGE COATING

NOTES:

1. HARDWARE QUANTITIES IN INSULATING FLANGE KIT WILL VARY BASED ON GASKET PATTERN AND PIPE SIZE.
2. FOR BELOW GROUND INSTALLATIONS, INSTALL SINGLE-WASHER KITS WITH THE INSULATING WASHERS ONLY ON THE FOREIGN SIDE OF THE FLANGES.
3. THREADED STUD STYLE KITS ARE NOT PERMITTED.
4. INSTALL TYPE 316SS BOLTS, NUTS AND WASHERS.
5. PERFORM OHMMETER TEST TO DEMONSTRATE INSULATION IS FUNCTIONAL.

NOT TO SCALE

REVISION			APPROVED:	
NO.	APPROVED	DATE		DATE
1	VRW	07/30/18	<i>Nelson D. Nelson</i> NELSON D. NELSON, PE PUBLIC WORKS DIRECTOR	7/30/2018
			<i>Vernon R. Weisman</i> VERNON R. WEISMAN, PE DISTRICT ENGINEER	7/30/2018



CITY OF CORONA

STD 458

SHEET 1 OF 1