

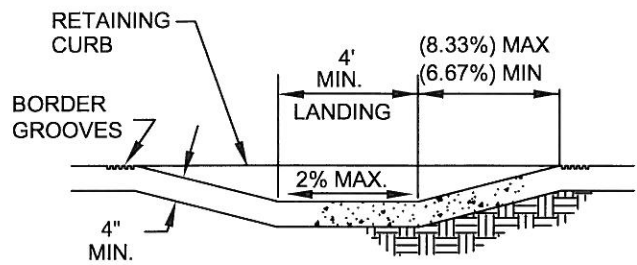


**SECTION "A-A"**

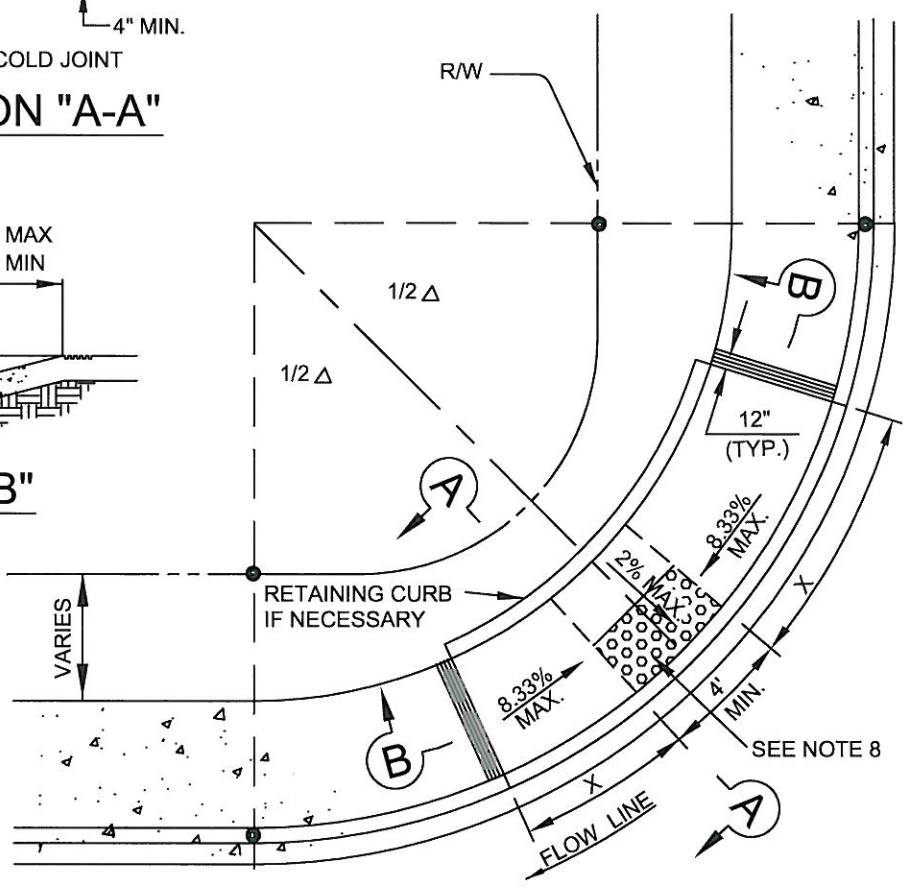

**SECTION "B-B"**

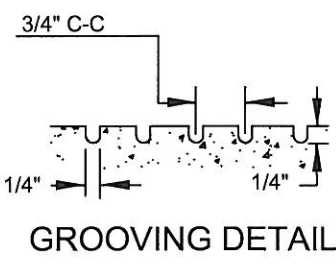

**NOTES:**

1. TYPE II RAMP MAY ONLY BE USED WHEN MINIMUM DISTANCE OF 4' AT TOP OF TYPE I RAMP CANNOT BE ACHIEVED.
2. ALL ACCESS RAMPS SHALL BE CONSTRUCTED TO THE MOST CURRENT REQUIREMENTS OF THE AMERICANS WITH DISABILITIES ACT (ADA) STANDARDS/CALIFORNIA CODE OF REGULATIONS TITLE 24-ACCESSIBILITY REGULATIONS. ADJUSTMENTS SHALL BE MADE IN THE FIELD TO ACHIEVE RAMP CONDITIONS.
3. CONCRETE SHALL BE CLASS 560-C-3250, CURED WITH CLEAR CURING COMPOUND.
4. CROSS SLOPE OF LANDING MAY NOT EXCEED (2.0%).
5. X SHALL HAVE A MAXIMUM SLOPE OF (8.33%), AND A MINIMUM SLOPE OF (6.67%).
6. GROOVED BORDER SHALL BE 12" WIDE ALONG THE TOP OF THE RAMP AT THE LEVEL SURFACE OF THE SIDEWALK. OMIT GROOVES ADJACENT TO NON-PAVED AREAS.
7. RAMP SURFACE AND FLARED SIDES SHALL BE SLIP-RESISTANT AND SHALL BE OF CONTRASTING FINISH FROM ADJACENT SIDEWALK (MEDIUM BROOM FINISH OR EQUIVALENT).
8. THE CENTER PORTION OF ALL PEDESTRIAN RAMPS SHALL CONTAIN TRUNCATED DOMES IN ACCORDANCE WITH THE LATEST EDITION OF THE ADA.



APPROVED BY:			
		11/23/09	
CITY ENGINEER		DATE	
KIP D. FIELD			
REVISION	DESCRIPTION	BY	DATE

<b>CITY OF CORONA</b>	
<b>PEDESTRIAN RAMP: TYPE II</b>	
STANDARD PLAN NUMBER: <b>147</b>	SHT 1 OF 1